


Corrosion rate measurement in black liquor concentrator 75% DS, 140 Gr.C

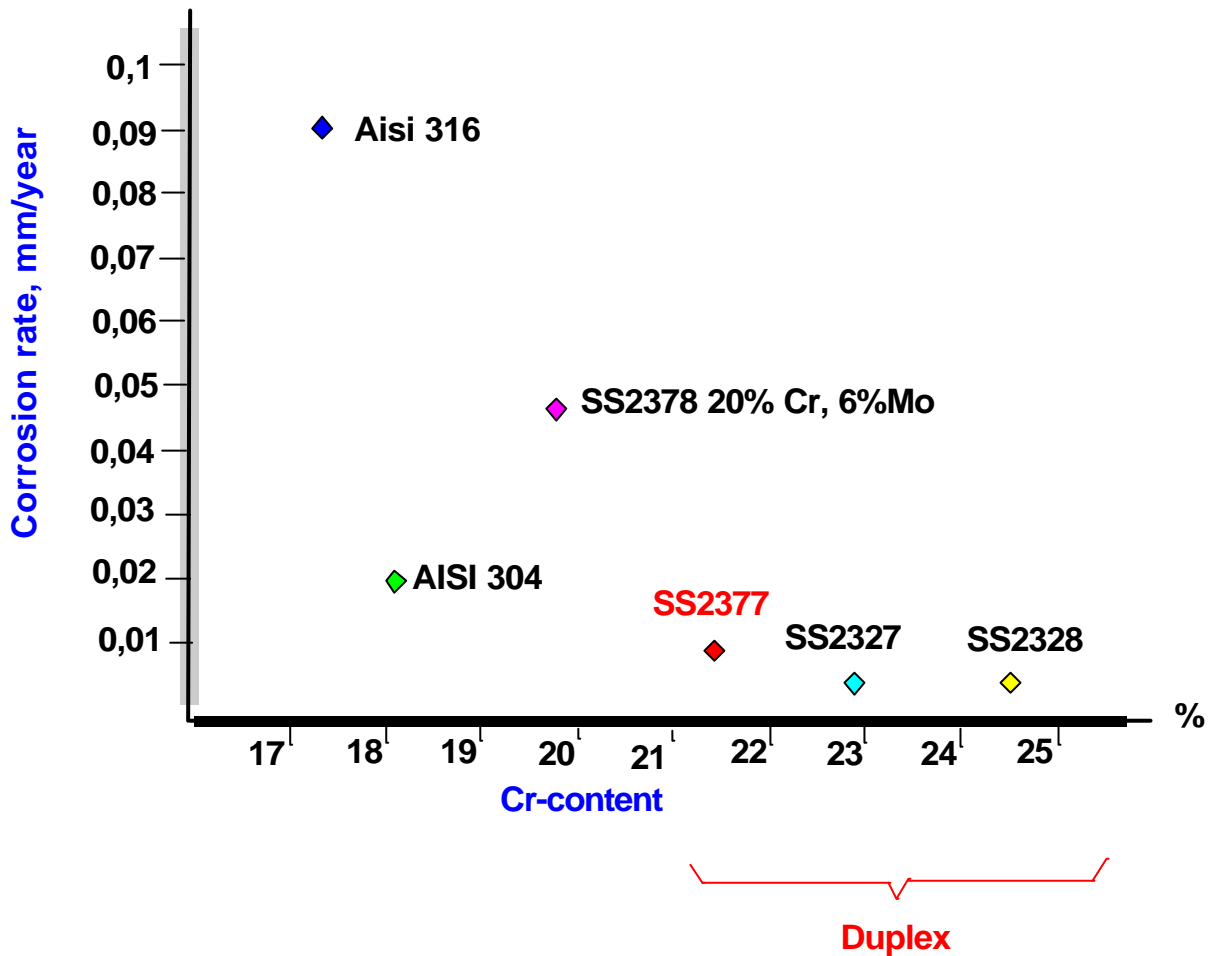

Datum 00-06-05	Corrosion rate measurement in black liquor concentrator 75% DS, 140 Gr.C	Instrumentation Tel./fax +46 (0)8 744 40 06
Skala 1:2		Ritningsnr. 4-60006
Ritad av M.M.		